Work of providing, **laying of 150mm dia DI water supply at T C Palya road to Club road dead end coming under K R Puram Service Station of AEE E-2-4 sub Division**

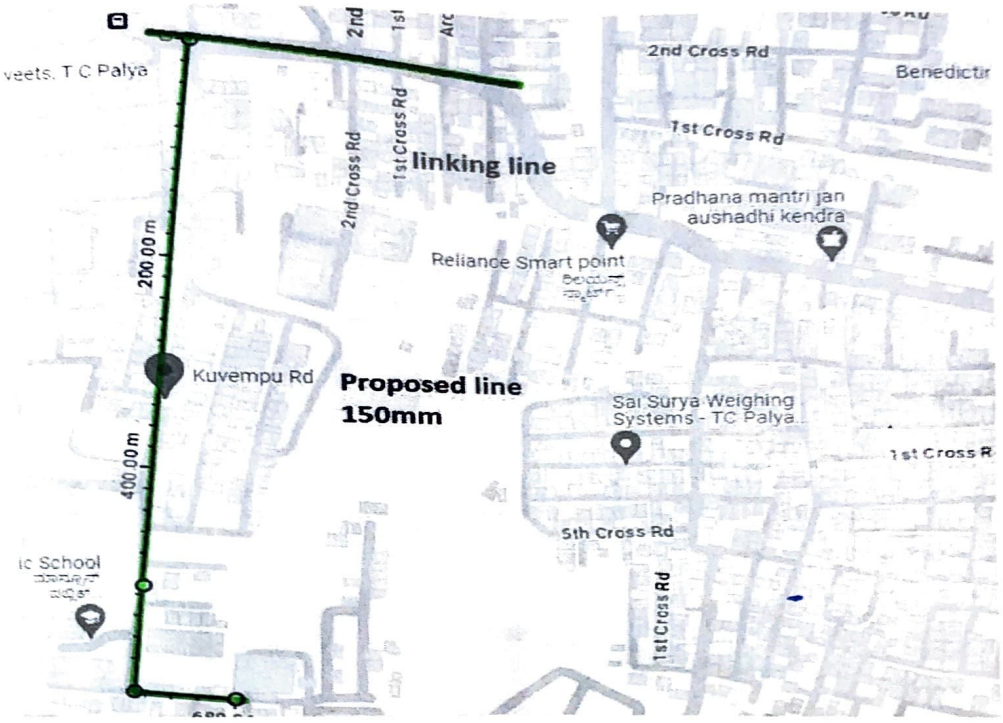

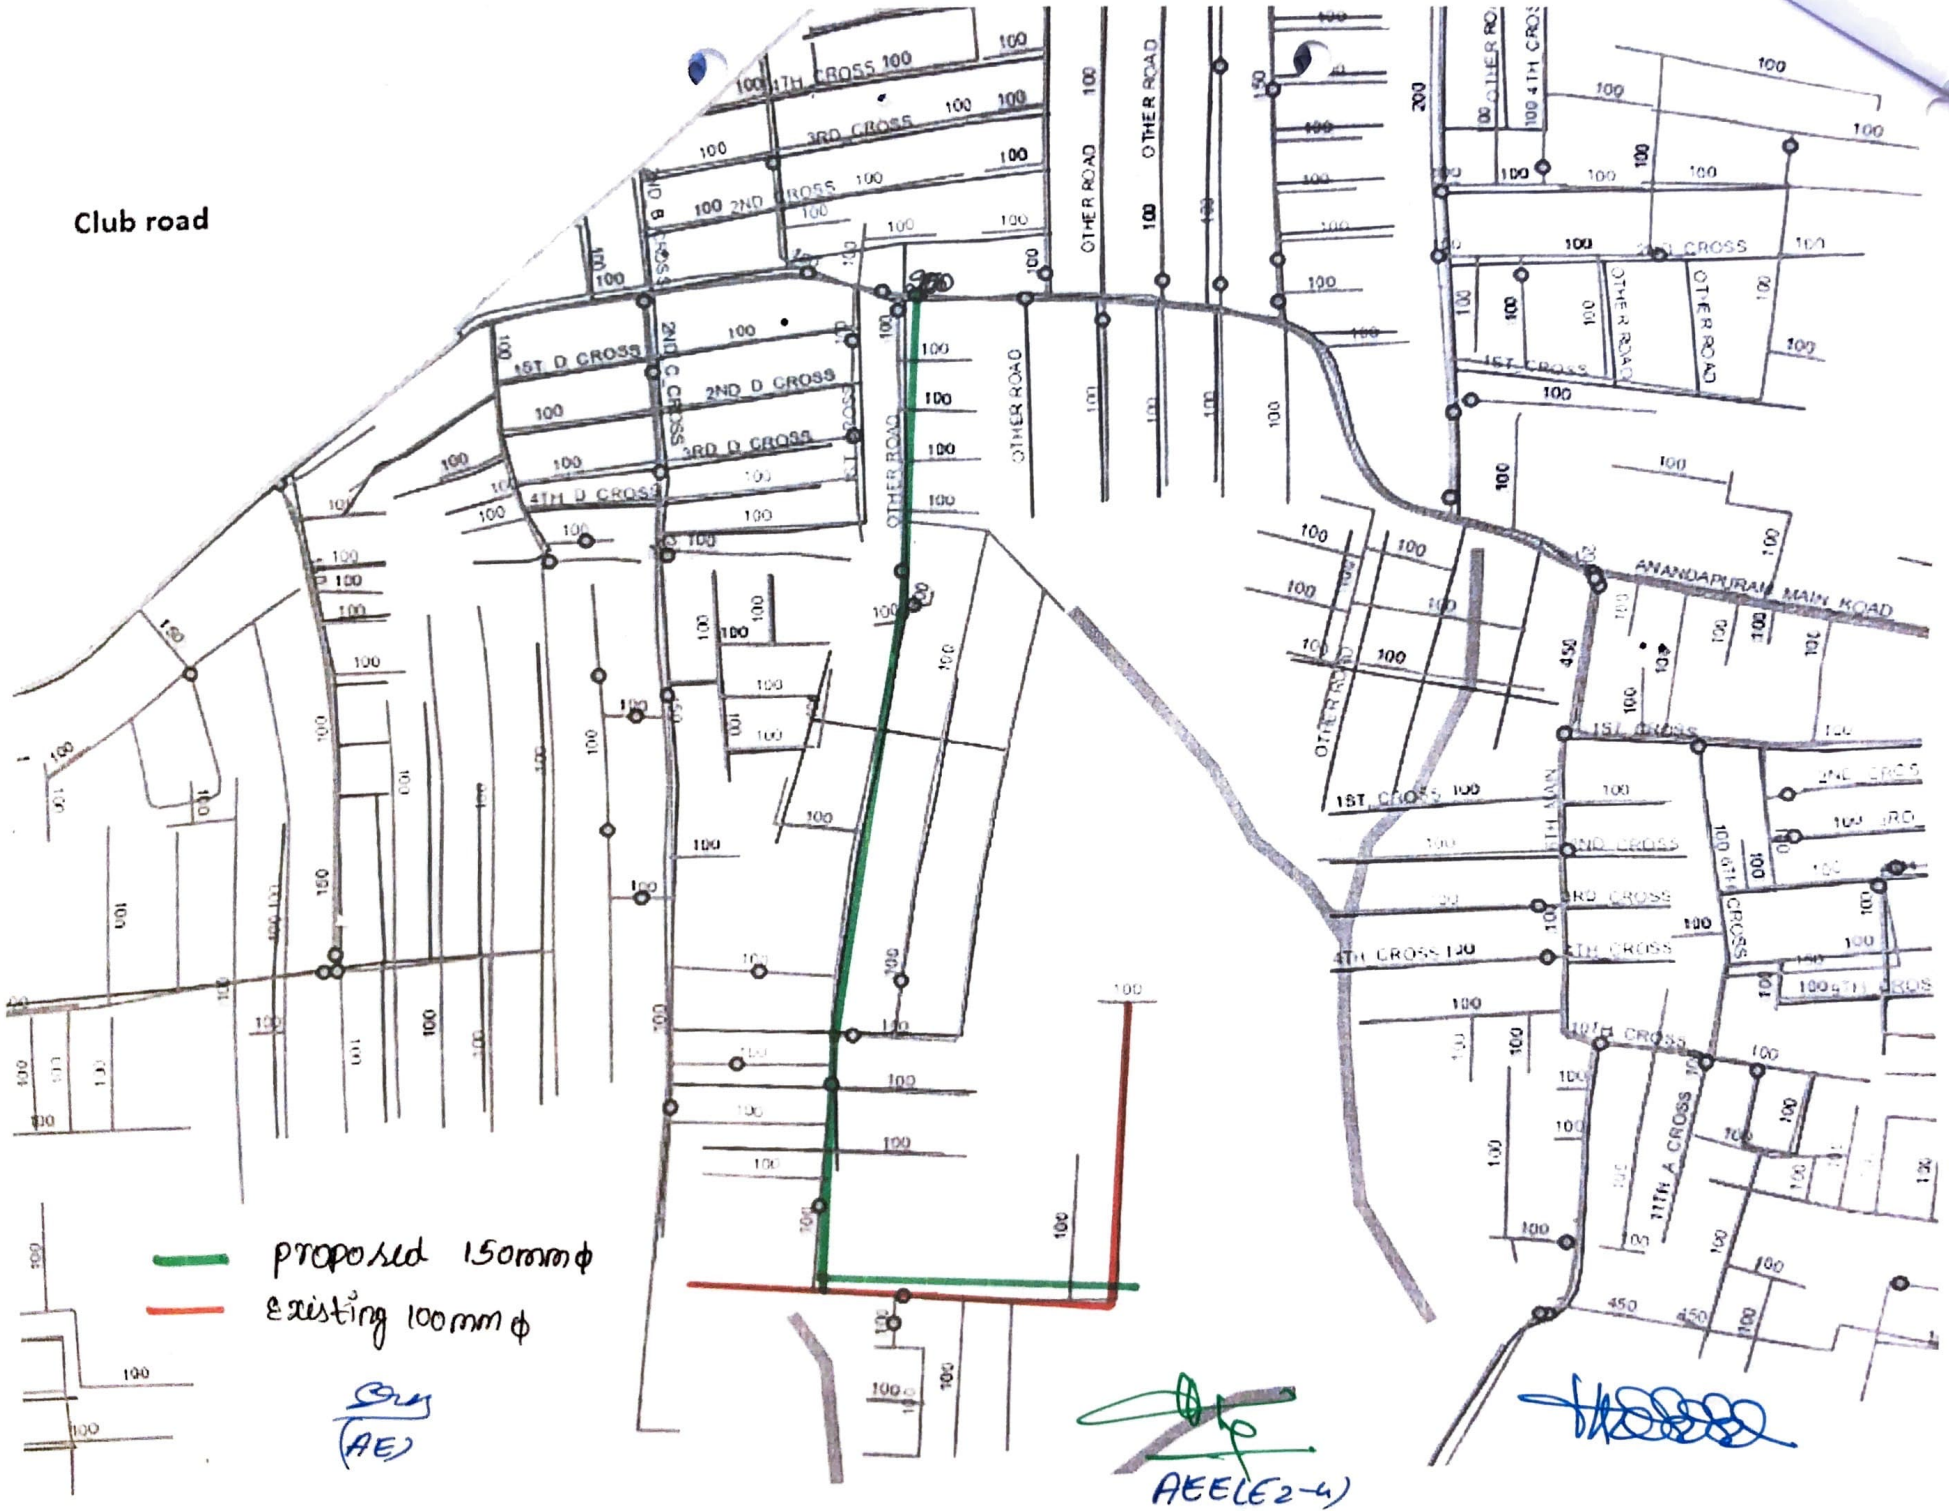
Club road
1ST D CROSS
2ND D CROSS
3RD D CROSS
4TH D CROSS
OTHER ROAD
ANANDAPURAM MAIN ROAD
1ST CROSS
2ND CROSS
3RD CROSS
4TH CROSS
proposed 150mm ϕ
existing 100mm ϕ
(AE)
AEE(E2-4)

Work of providing, laying of 150 mm dia DI Water supply line at T.C. palya main road to Club road end coming under K.R. Puram. SLS of AEE E-2-H SID.

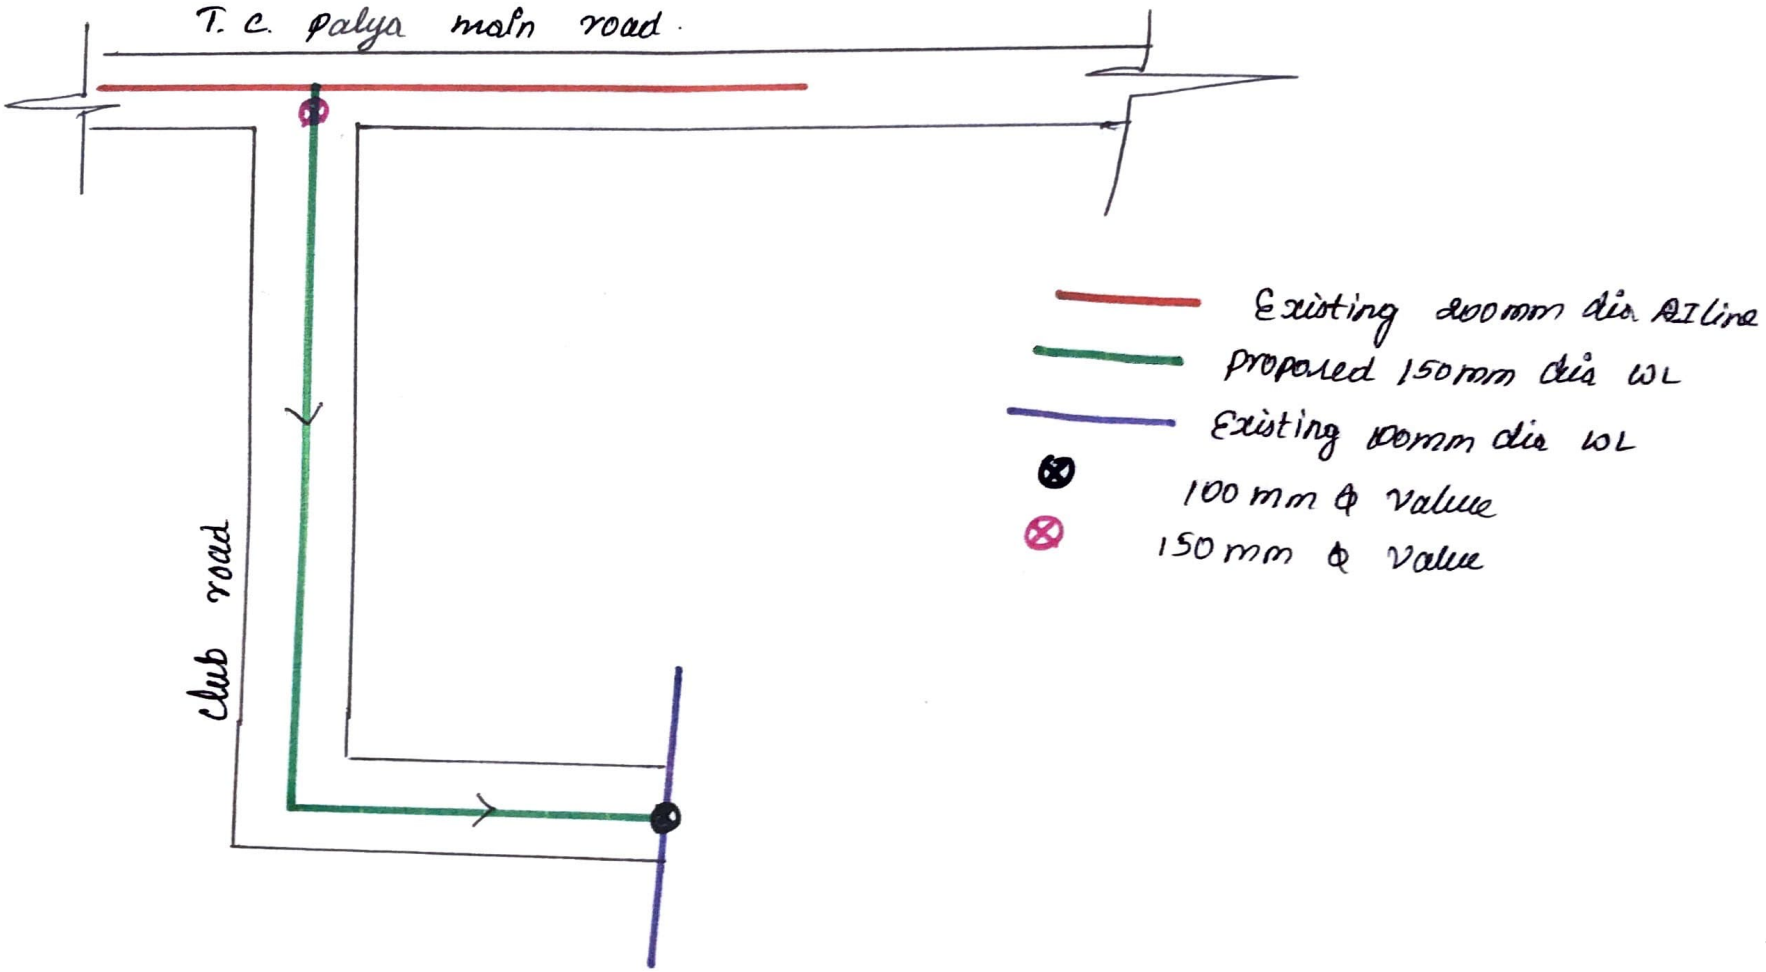
T. C. palya main road.
Club road
Existing 200mm dia DI line
Proposed 150mm dia WL
Existing 100mm dia WL
100 mm ϕ Valve
150 mm ϕ Valve

(AE)

AEE (E-2-H)

EE (E-2)